


Pre-treatment

Input: 5 – 15°C

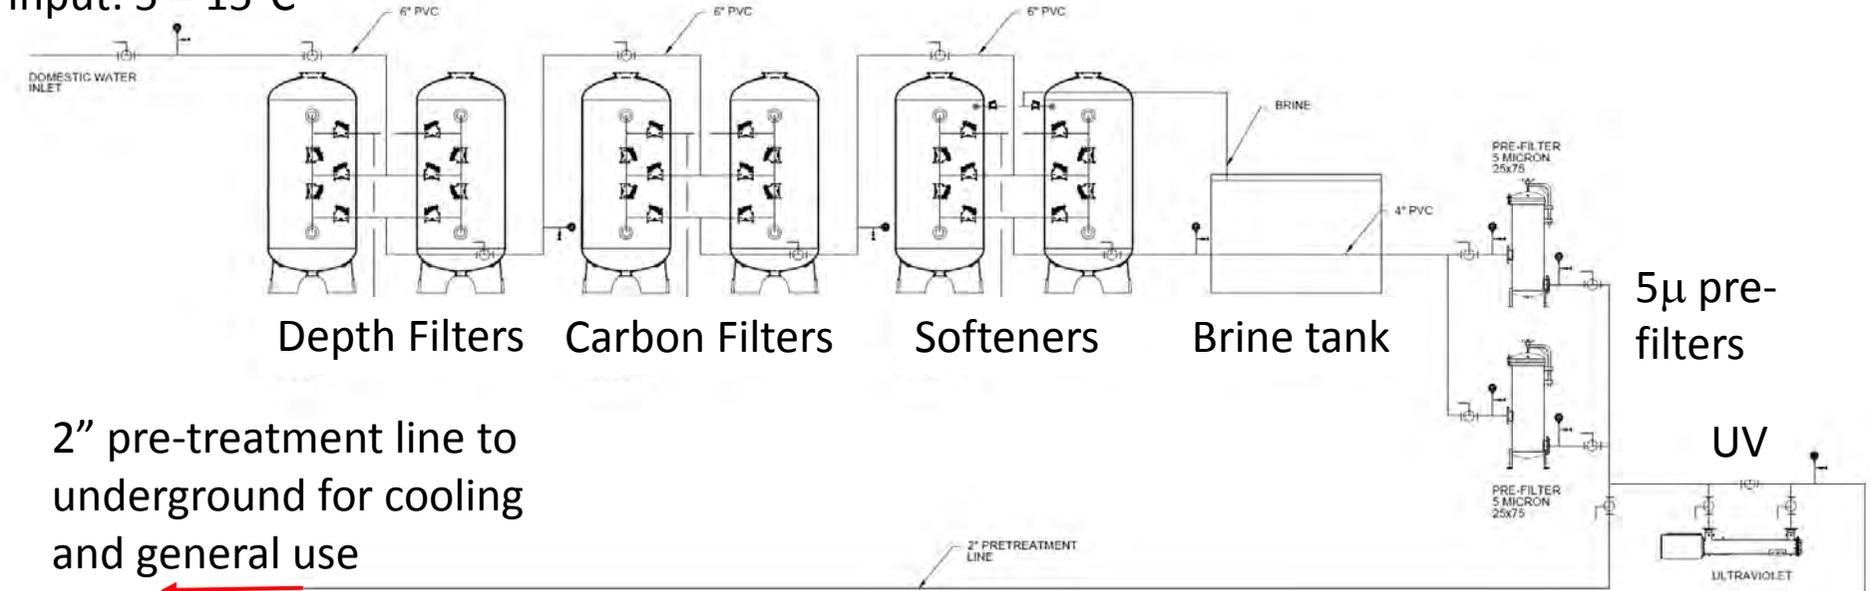


2" pre-treatment line to underground for cooling and general use

4" pipe to DI section

TOC
Charges organics so DI can remove

Two-stage RO

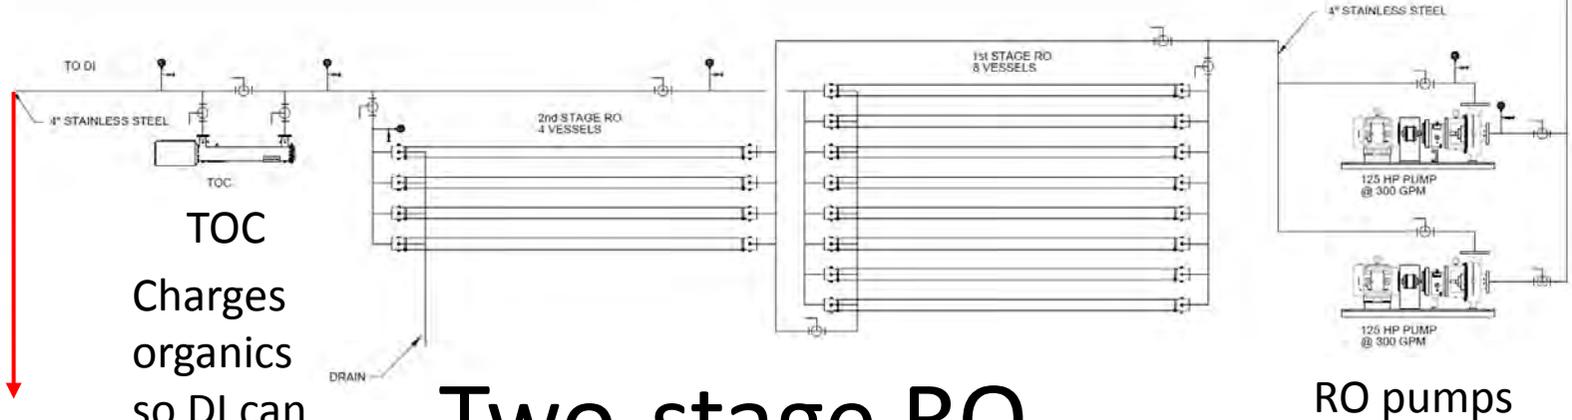

RO pumps